

INTERNAL WALLING	Scrape off the existing paint, repaint with silk vinyl finish colour paint.
CEILING	Replace worn out ceiling linings with 9mm thick chipboard ceiling linings.
FLOOR SKIRTING	Provide 100mmx25mm thick mahogany skirting - varnished to approval.
ELECTRICAL FITTINGS	Replace all broken switches, sockets, bulb holders. Fit 20W energy saver bulbs in all the areas.
OTHER FIXTURES	Replace existing pelmet boxes with pre-fabricated curtain rails and shear holders to architect's
	approval.
	Install mahogany picture rails (50x25mm) in the main hall and kitchen and the.
	Undersink
	cupboards and Store shelving in painted block board - 20mm thick.
INTERNAL DOORS	Scrape off the existing paint, and finish with a paint of the approved colour.

ROOF	Paint GCI sheets - undercoat and two green coats of roof paint.
FASCIA AND BARGEBOARDS	New 250x25mm soft wood finish, painted to architects details.
EXTERNAL WALLING	Wire brush and clean the existing stone cladding. Half clad - up to 900mm high cobble stone and finish with 2 pack clear epoxy -
	2mm. For gable end walls and all wall finishes above 900mm, separate with a concrete lip round the house and paint to approval.
	externaly
PAVEMENT	Install paving slabs round the house for splash apron - 1200mm all round, front 2400mm
EAVES	Paint the rafter extensions to the eaves with an approved KWS colour.
DOORS	Exterior Steel Casement - 5mm thick glass panels.
WATER	Collect all rain water with well secured plastic water gutters and downpipes and drain into two 5000ltres plastic water tanks.

- 1. All dimensions in millimeters unless otherwise specified.
- 2. All dimensions should be checked on site and any discrepancies reported to the architect
- 3. All works should be carried out in accordance with ALL other regulations particularly NEMA.
- 4. Use figured dimensions only do not scale from the drawing.
- 5. All walls are to be reinforced with hoop iron at every alternate course.
- 6. DPC to be laid under walls and to be 150 mm above finished ground level.
- 7. All the drainage pipes passing under building and driveway to be encased in 150mm thick concrete surround.
- 8. 500mm gauge polythene DPM and anti termite to be provided under slab.
- 9. Concrete shall be of class 1:2:4 unless otherwise stated.
- 10. Mortar for plastering shall be in the ratio of 1:4.
- 11. These drawings do not constitute engineering drawings .They should be used together with Structural Engineer's drawings.

		REVISIONS
No.	DATE.	DESCRIPTION

PROPOSED STAFF RESIDENTIAL FACILITIES AT MARSABIT NATIONAL PARK.

Drawing title:

OFFICE AND GATE HOUSE - KARARE

Client : KENYA WILDLIFE SERVICE
P.O. BOX 40241 00100 NAIROBI
KENYA

Drawn by :	Kathuli P.F
Architect :	
PATRICK KATHULI .F.	
Date :	
MARCH - 2017	

round Floor



INTERNAL WALLING	Scrape off the existing paint, repaint with silk vinyl finish colour paint.
CEILING	Replace worn out ceiling linings with 9mm thick chipboard ceiling linings.
FLOOR SKIRTING	Provide 100mmx25mm thick mahogany skirting - varnished to approval.
PLUMBING FIXTURES	Replace all broken ones, clean those in a good state for use.
ELECTRICAL FITTINGS	Replace all broken switches, sockets, bulb holders. Fit 20W energy saver bulbs in all the areas.
OTHER FIXTURES	Replace existing pelmet boxes with pre-fabricated curtain rails and shear holders to architect's
	approval.
	Install mahogany picture rails (50x25mm) in the bedroom walls, kitchen and the sitting rooms.
	Undersink
	cupboards and Store shelving in painted block board - 20mm thick.
INTERNAL DOORS	Scrape off the existing paint, and finish with a paint of the approved colour.

ROOF	Paint GCI sheets - undercoat and two green coats of roof paint.
FASCIA AND BARGEBOARDS	New 150x25mm soft wood finish, painted to architects details.
EXTERNAL WALLING	Wire brush and clean the existing stone cladding. Half clad - up to 900mm high cobble stone and finish with 2 pack clear epoxy -
	2mm. For gable end walls and all wall finishes above 900mm, separate with a concrete lip round the house and paint to approval.
	externaly
PAVEMENT	Install paving slabs round the house for splash apron - 1200mm all round, front 2400mm
EAVES	Paint the rafter extensions to the eaves with an approved KWS colour.
DOORS	Exterior Steel Casement - 5mm thick glass panels.
WATER	Collect all rain water with well secured plastic water gutters and downpipes and drain into two 2300ltres plastic water tanks.

- 1. All dimensions in millimeters unless otherwise specified.
- 2. All dimensions should be checked on site and any discrepancies reported to the architect
- 3. All works should be carried out in accordance with ALL other regulations particularly NEMA.
- 4. Use figured dimensions only do not scale from the drawing.
- 5. All walls are to be reinforced with hoop iron at every alternate course.
- 6. DPC to be laid under walls and to be 150 mm above finished ground level.
- 7. All the drainage pipes passing under building and driveway to be encased in 150mm thick concrete surround.
- 8. 500mm gauge polythene DPM and anti termite to be provided under slab.
- 9. Concrete shall be of class 1:2:4 unless otherwise stated.
- 10. Mortar for plastering shall be in the ratio of 1:4.
- 11. These drawings do not constitute engineering drawings. They should be used together with Structural Engineer's drawings.

	REVISIONS	
No.	DATE.	DESCRIPTION

# PROPOSED STAFF RESIDENTIAL FACILITIES AT MARSABIT NATIONAL PARK.

Drawir title :

JUNIOR STAFF HOUSES - PARK HQS


Client :

KENYA WILDLIFE SERVICE
P.O. BOX 40241 00100 NAIROBI
KENYA

Drawn by :	Kathuli P.F
Architect :	
PATRICK KATHULI .F.	
Date :	
MARCH - 2017	

unional Flags

A.E

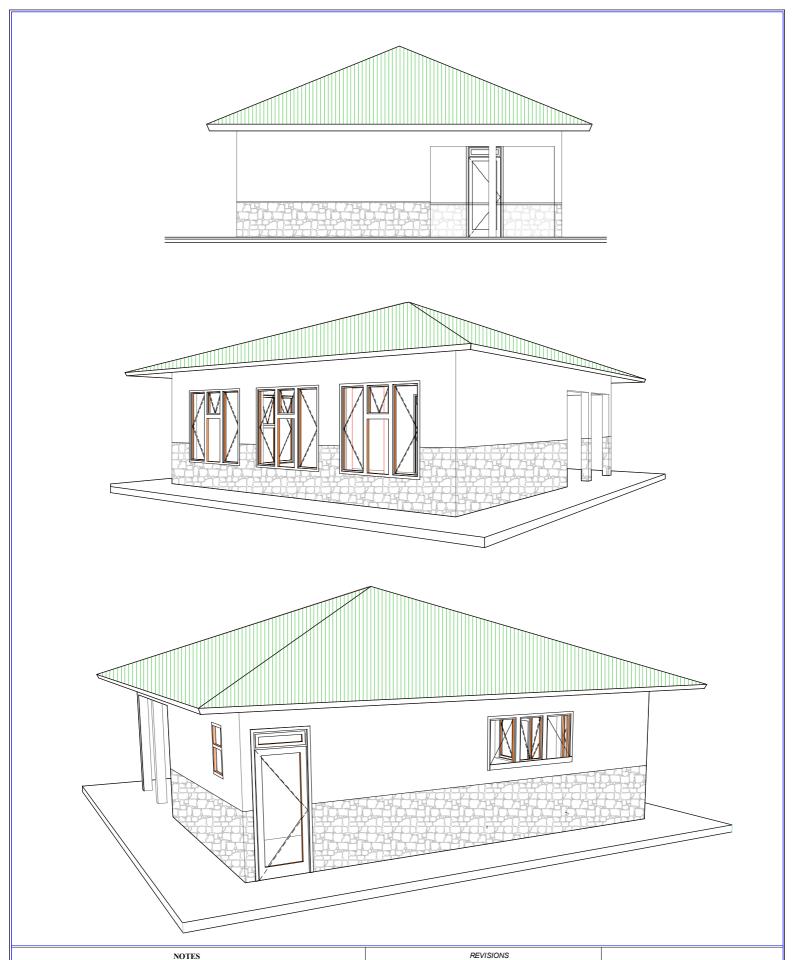

- 1. All dimensions in millimeters unless otherwise specified.
- 2. All dimensions should be checked on site and any discrepancies reported to the architect.
- 3. All works should be carried out in accordance with ALL other regulations particularly NEMA.
- $4. \ Use \ figured \ dimensions \ only$  do not scale from the drawing.
- 5. All walls are to be reinforced with hoop iron at every alternate course.
- 6. DPC to be laid under walls and to be 150 mm above finished ground level.
- 7. All the drainage pipes passing under building and driveway to be encased in 150mm thick concrete surround.
- 8. 500mm gauge polythene DPM and anti termite to be provided under slab.

- 9. Concrete shall be of class 1:2:4 unless otherwise stated.
- 10. Mortar for plastering shall be in the ratio of 1:4.
- 11. These drawings do not constitute engineering drawings. They should be used together with Structural Engineer's drawings.


PROPOSI	DESCRIPTION		DATE.	
Drawing title :			No.	
Client : KE				
F.O. BOX				
Drawn by :				
Ambitont :				


### SED SENIOR STAFF MESS.

**VIEWS** 


2

ENYA WILDLIFE SERVICE X 40241 00100 NAIROBI KENYA Kathuli P.F PATRICK KATHULI .F. MARCH - 2017

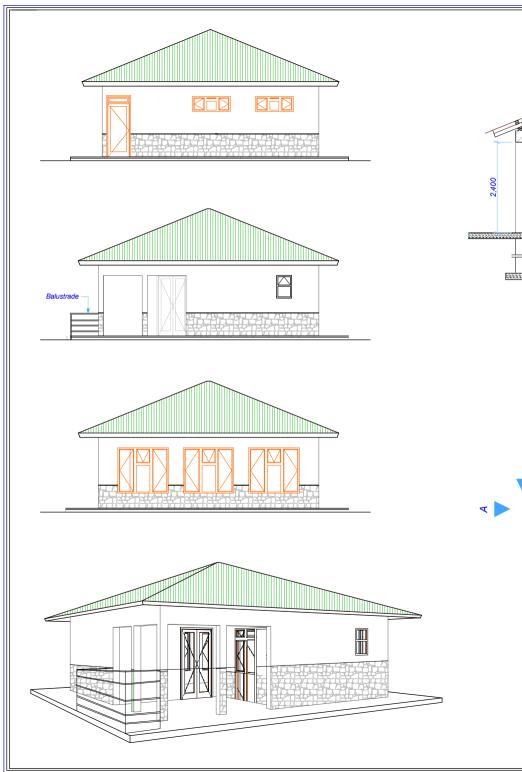

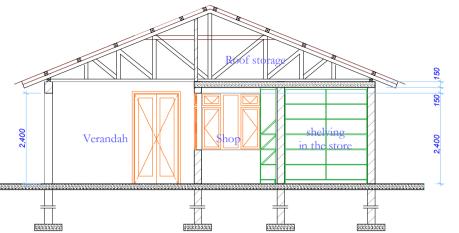

## **SECTION X - X**

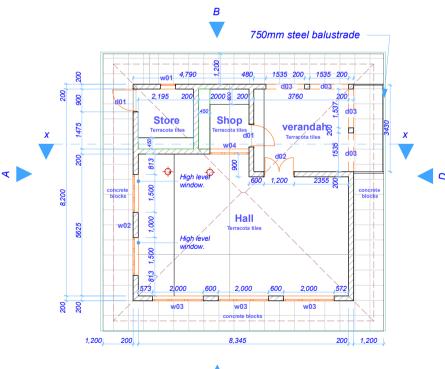



**LAYOUT PLAN** 

#### NOTES

- 1. All dimensions in millimeters unless otherwise specified.
- All dimensions should be checked on site and any discrepancies reported to the architect
- 3. All works should be carried out in accordance with ALL other regulations particularly NEMA.
- 4. Use figured dimensions only do not scale from the drawing.
- 5. All walls are to be reinforced with hoop iron at every alternate course.
- 6. DPC to be laid under walls and to be 150 mm above finished ground level.
- 7. All the drainage pipes passing under building and driveway to be encased in 150mm thick concrete surround.
- 8. 500mm gauge polythene DPM and anti termite to be provided under slab.
- 9. Concrete shall be of class 1:2:4 unless otherwise stated.
- 10. Mortar for plastering shall be in the ratio of 1:4.
- 11. These drawings do not constitute engineering drawings. They should be used together with Structural Engineer's drawings.

REVISIONS		
DATE.	DESCRIPTION	
	DATE.	

# PROPOSED STAFF RESIDENTIAL FACILITIES AT MARSABIT NATIONAL PARK.


Drawing title :

SENIOR STAFF MESS

KENYA

Client: KENYA WILDLIFE SERVICE
P.O. BOX 40241 00100 NAIROBI

Drawn by :	Kathuli P.F	
Architect :		
PATRICK KATHULI .F.		
	VIEWS	1
Date :		
MARCH - 2017		

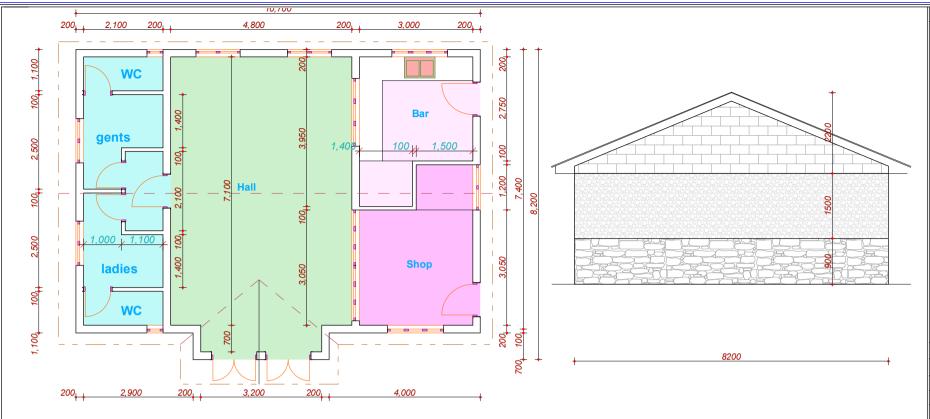

INTERNAL WALLING	Scrape off the existing paint, repaint with silk vinyl finish colour paint.
CEILING	Replace worn out ceiling linings with 9mm thick chipboard ceiling linings.
FLOOR SKIRTING	Provide 100mmx25mm thick mahogany skirting - varnished to approval.
PLUMBING FIXTURES	Replace all broken ones, clean those in a good state for use.
ELECTRICAL FITTINGS	Replace all broken switches, sockets, bulb holders. Fit 20W energy saver bulbs in all the areas.
OTHER FIXTURES	Replace existing pelmet boxes with pre-fabricated curtain rails and shear holders to architect's
	approval.
	Install mahogany picture rails (50x25mm) in the main hall and kitchen and the.
	Undersink
	cupboards and Store shelving in painted block board - 20mm thick.
INTERNAL DOORS	Scrape off the existing paint, and finish with a paint of the approved colour.

ROOF	Paint GCl sheets - undercoat and two green coats of roof paint.
FASCIA AND BARGEBOARDS	New 250x25mm soft wood finish, painted to architects details.
EXTERNAL WALLING	Wire brush and clean the existing stone cladding. Half clad - up to 900mm high cobble stone and finish with 2 pack clear epoxy
	2mm. For gable end walls and all wall finishes above 900mm, separate with a concrete lip round the house and paint to approval.
	externaly
PAVEMENT	Install paving slabs round the house for splash apron - 1200mm all round, front 2400mm
EAVES	Paint the rafter extensions to the eaves with an approved KWS colour.
DOORS	Exterior Steel Casement - 5mm thick glass panels.
WATER	Collect all rain water with well secured plastic water gutters and downpipes and drain into two 5000ltres plastic water tanks.

- All dimensions in millimeters unless otherwise specified.
- 2. All dimensions should be checked on site and any discrepancies reported to the architect
- 3. All works should be carried out in accordance with ALL other regulations particularly NEMA.
- 4. Use figured dimensions only do not scale from the drawing.
- 5. All walls are to be reinforced with hoop iron at every alternate course.
- 6. DPC to be laid under walls and to be 150 mm above finished ground level.
- All the drainage pipes passing under building and driveway to be encased in 150mm thick concrete surround.
- 8. 500mm gauge polythene DPM and anti termite to be provided under slab.
- 9. Concrete shall be of class 1:2:4 unless otherwise stated.
- 10. Mortar for plastering shall be in the ratio of 1:4.
- 11. These drawings do not constitute engineering drawings. They should be used together with Structural Engineer's drawings.

REVISIONS

DATE.	DESCRIPTION
	DESCRIPTION

# PROPOSED STAFF RESIDENTIAL FACILITIES AT MARSABIT NATIONAL PARK.

Drawing title:

STAFF CANTEEN

Client : KENYA WILDLIFE SERVICE

P.O. BOX 40241 00100 NAIROBI KENYA

Drawn by :	Kathuli P.F
Architect :	
PATRICK KATHULI .F.	
Date :	
MARCH - 2017	